


Notes

1. All measurements are in millimetres unless otherwise stated.

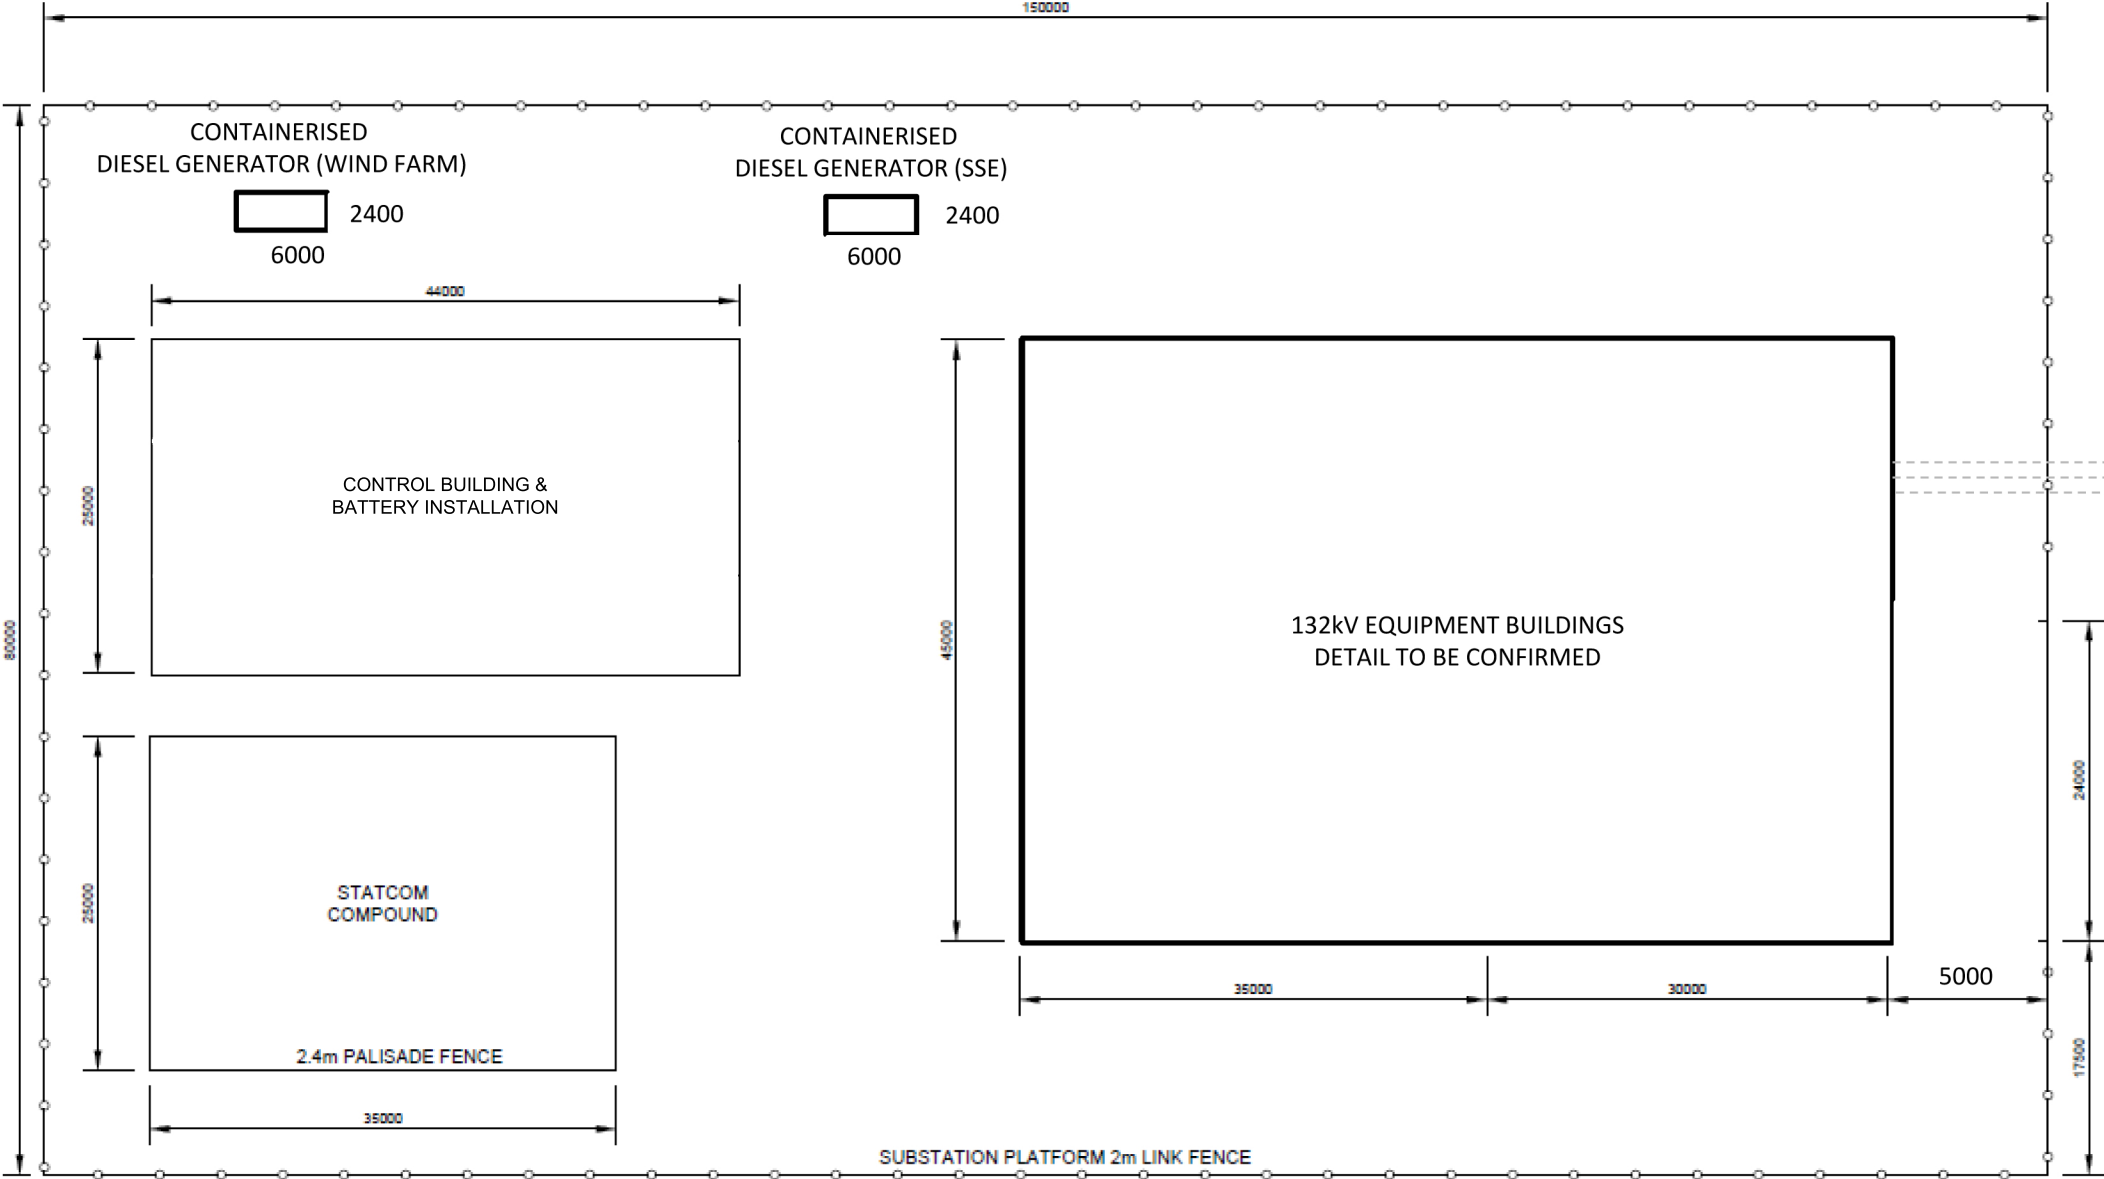

INDICATIVE
OVERHEAD
LINE (SSE)

NOT TO SCALE

Client



Stornoway Wind Farm
EIA Report

Figure 4.10a
Main substation and compound

February 2019



wood

Based upon EDF drawing EDFR-STWF-SL002.dwg

\\wood\lun\project\1\wood\stornoway\optimisation\res\early stage\main\substation-compound.dwg Originator: NEIL.PALTON