

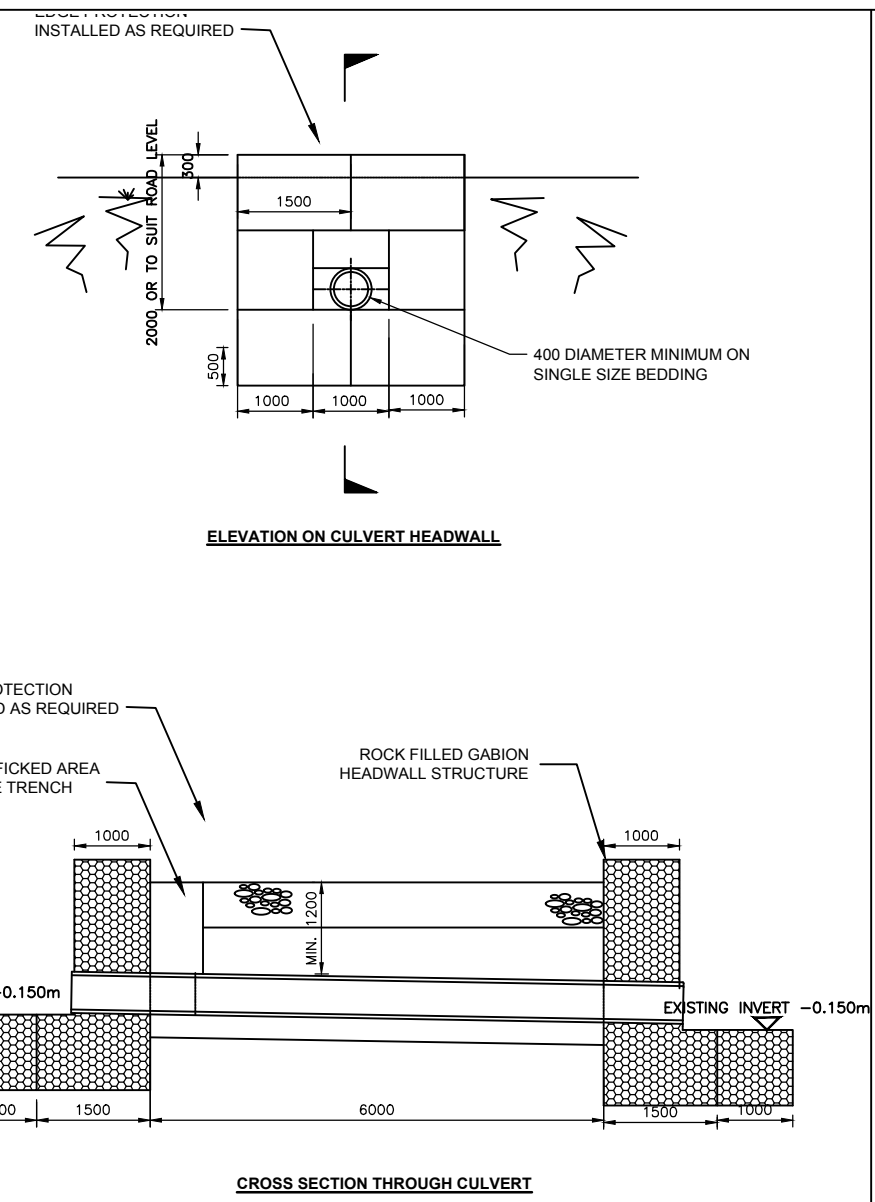


G:\GWM\DATA\PROJECT\40001 Stornoway Optimisation Feasibility Study\040 Design\ACAD\40001-Gos340a.dwg Originator: NELL PATTON

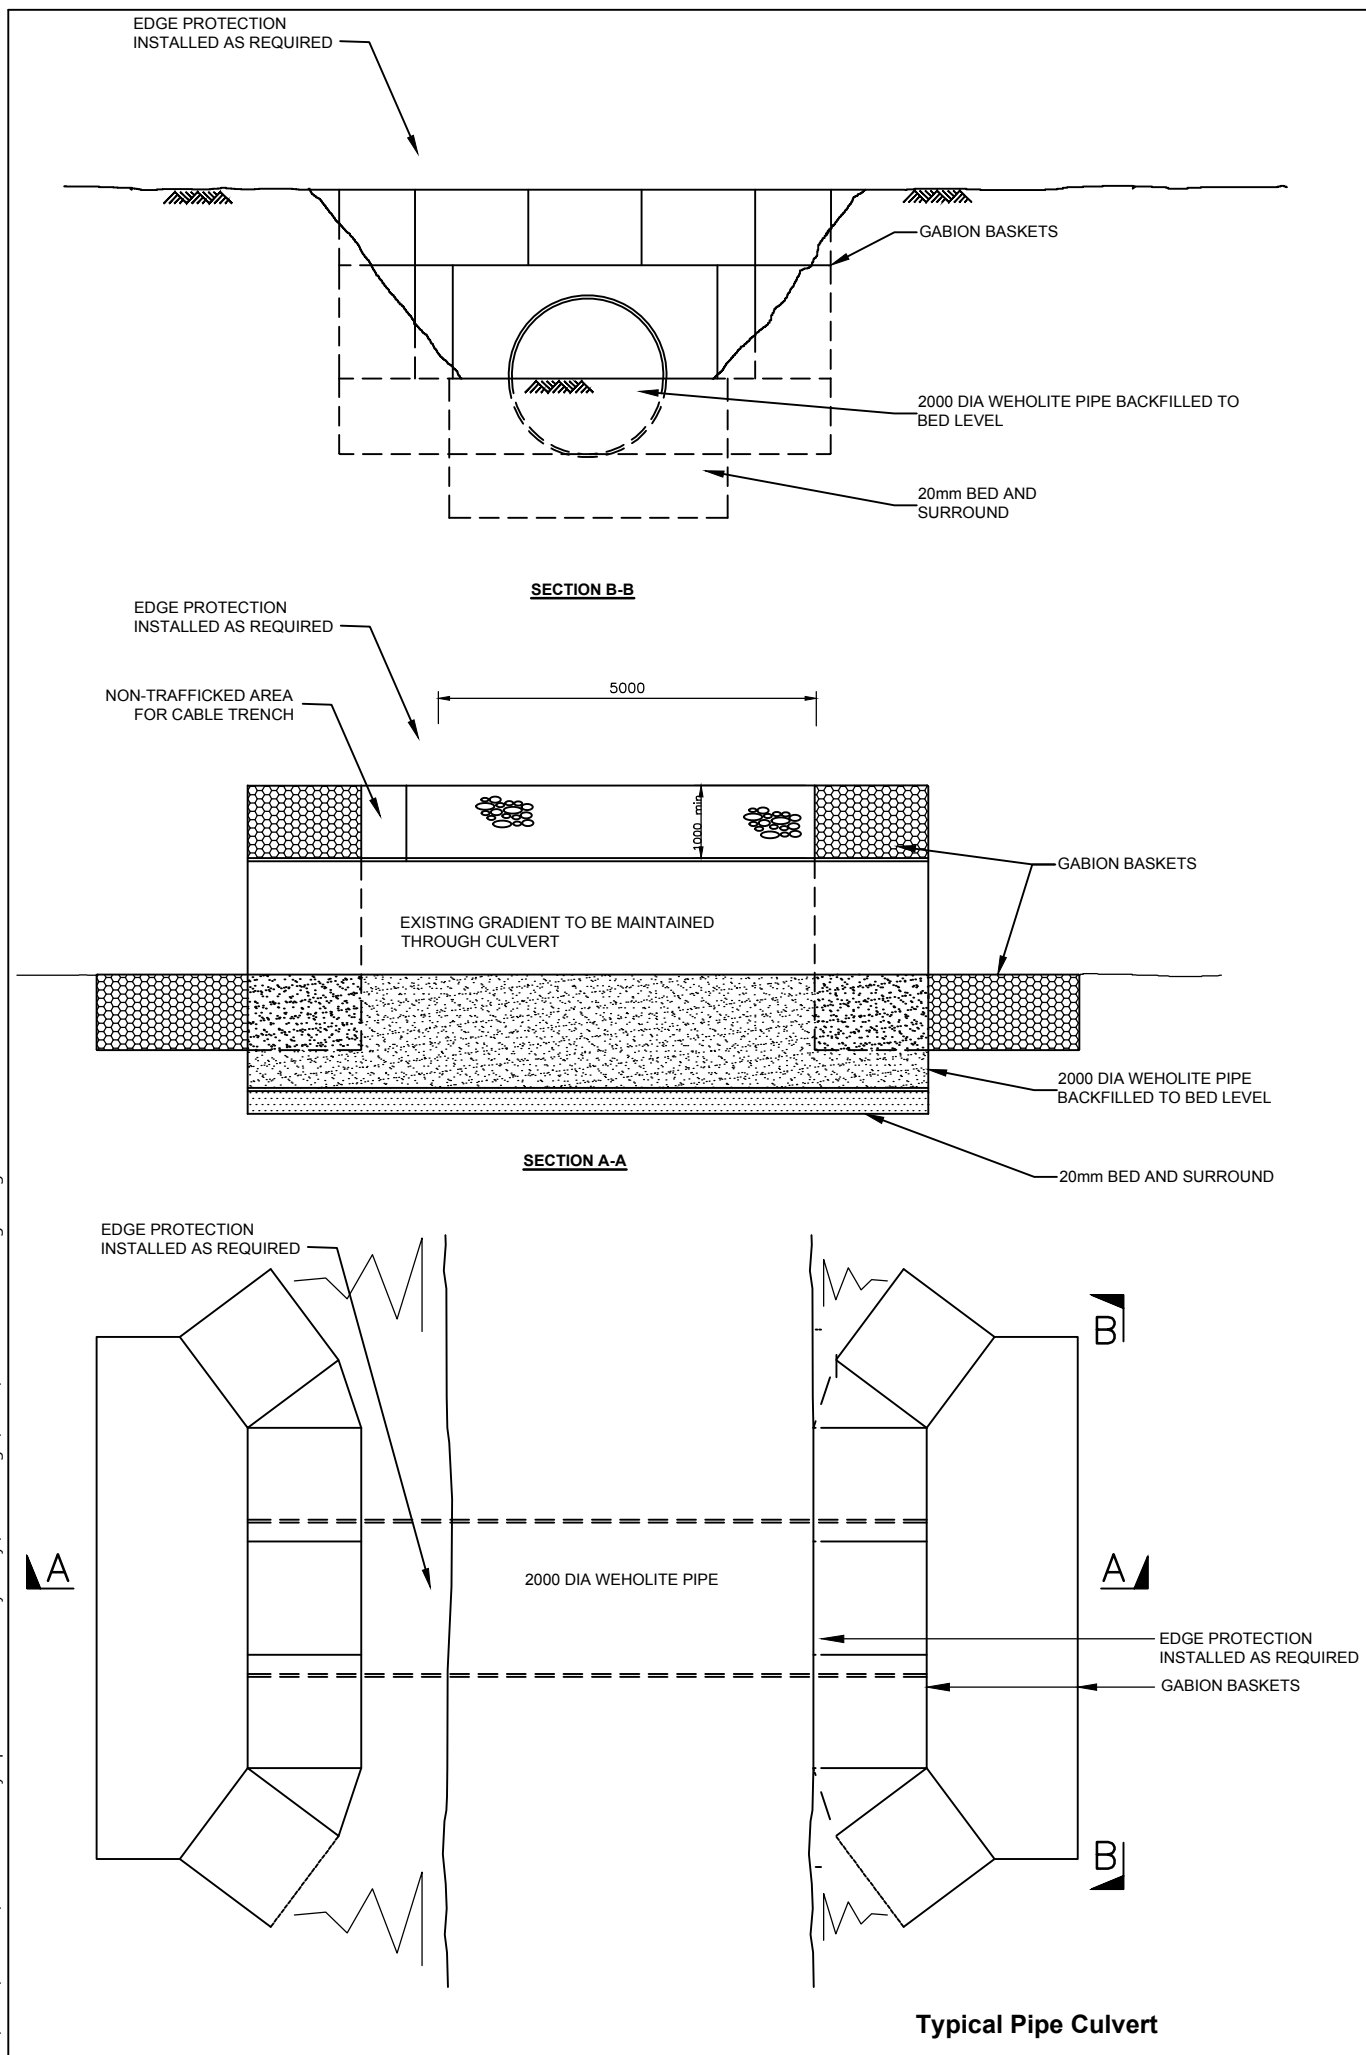

- Notes
1. All dimensions are in millimetres.
  2. The culvert details are indicative.
  3. Minimum diameters and invert levels based on CIRIA recommendations.
  4. Final culvert design is dependant on local topography, ground conditions and flows.



Client

Lewis Wind Power  
Cumhachd Gaoithe

Stornoway Wind Farm  
EIA Report

**Figure 4.9**  
**Typical culvert**

April 2019



Based upon drawing 35949-Gos286.dwg